SRI BAALAMURUGAN BOREWELLS

4, gangamma Compound, Opp. Canara Bank Bus Stop, Bellary Main Road, Hebbal Bangalore - 24
Mob : 9845020536, 9901920004

WORK REPORT

Vinayakanagara I st cross	No.
	Date :

S.No.	Particulars	Rft :	Water Yield	Remarks
1.	Size of The Borewell	165 mm		
2.	Total Deapth of The Borewell	980'		
3.	MS Casing Erected	186'		
4.	1st Water Source at the Deapth	297'		
5.	2nd Water Source at the Deapth	516'		
6.	3rd Water Source at the Deapth	725'		
7.	4th Water Source at the Deapth	910'		
8.	If any Silt, Boulders at the Deapth	—		
9.	Nature of Water	Sweet water		
10.	Moter Pump to be Used	15 x P 25 Stage		
11.	Any other Remarks	—		
12.	Total Yield of the Borewell	2'.3"		

Thanking You

Yours faithfuily
For Sri Baalamurugan Borewells

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL
DATA OF SURVEY

a) Name of the Party : AEE Byatarayanapura Sub Division.

b) Location of the Site : BBMP Ward No-5

c) Area of the land : Vinayakanagara 1st Cross

INVESTIGATION REPORT

1) GEOLOGY OF THE AREA :

2) Recommended Site for drilling :

3) Total depth to be drilled : 700 to 1000'

4) Approx. casing pipe required : 80' to 150'

5) No. of water bearing Zones : 1

6) No. of favourable spots marked : 1

7) Qty. of water expected : 1½" to 2".0

8) Method of survey carried out : GEO

9) Remarks :

HYDROGEOLOGIST
(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

P.T.O. : Terms & Conditions

BOREWELL SITE PLAN

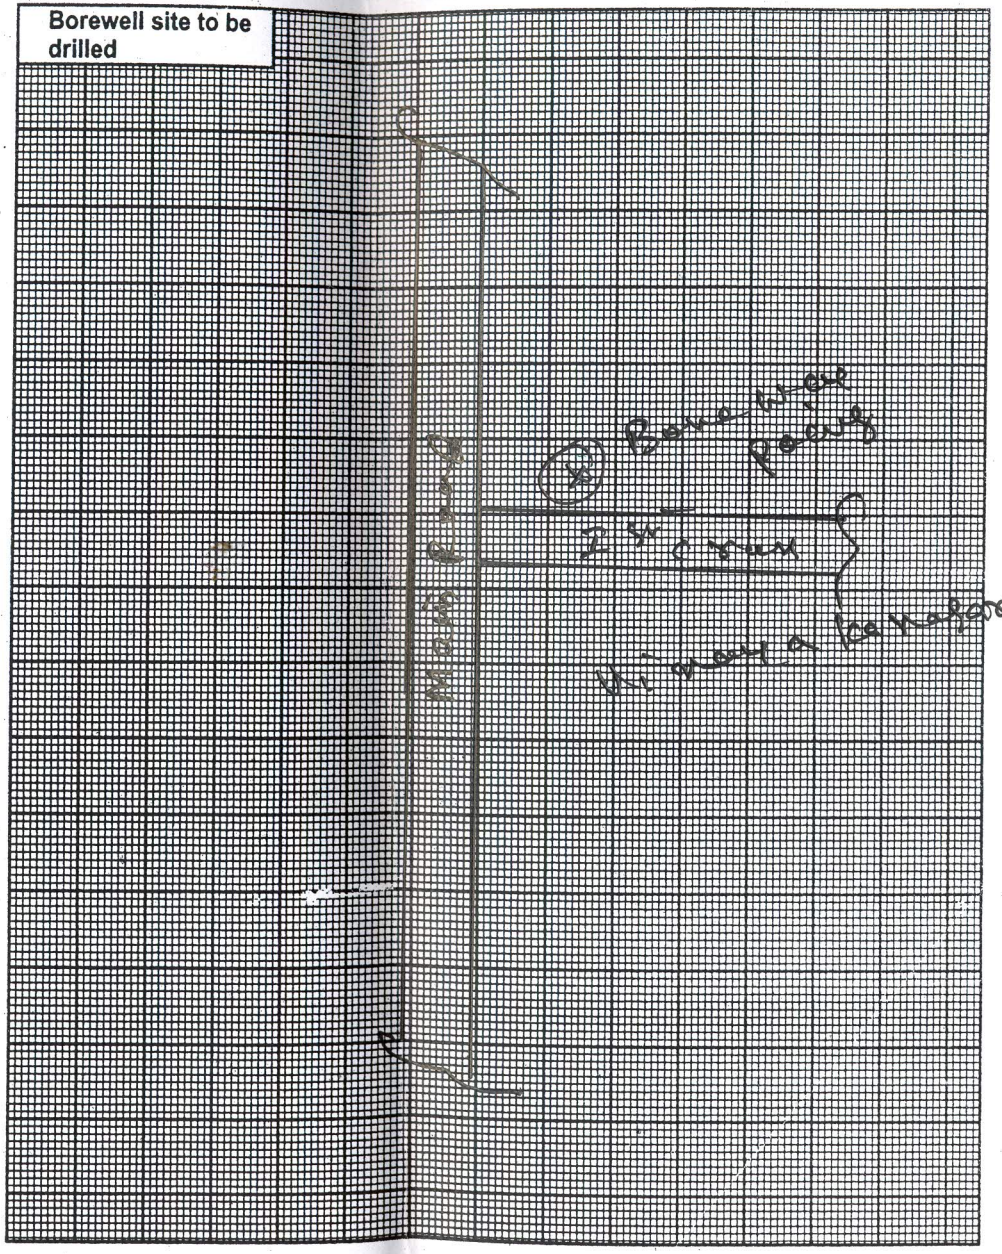

ward no - 5

Vinyakanagar

I st cross

(2)

ಸಹಾಯಕ ಅಭಿಯಂತರರು
ಬಿ.ಬಿ.ಎಂ.ಪಿ. ಬ್ಯಾಟರಾಯನಪುರ ಉಪ ವಿಭಾಗ

Assistant Executive Engineer
Byatarayanapura Sub Division
B.B.M.P Bangalore

ಸ್ಥಳ No.5. ಚಿನ್ನಾಯ್ಯನ ಪಾಳ್ಯ 1ನೇ ಕ್ರಾಸ್ ಪೈಪ್‌ಲೈನ್

ಸಹಾಯಕ ಕಾರ್ಯಪಾಲಕ ಅಭಿಯಂತರರು
ಬಿ.ಬಿ.ಎಂ.ಪಿ. ಬ್ಯಾಟರಾಯನಪುರ ಉಪ ವಿಭಾಗ

Assistant Executive Engineer
Byatarayan[illegible] Sub Division
BBMP [illegible]

W.No. 5. ಚಿನ್ನಾಯಕನಹಳ್ಳಿ 1st ಕ್ರಾಸ್ ಹೊಲಪಾಳ್ಯ

ಸಹಾಯಕ ಅಭಿಯಂತರರು
ಬಿ.ಬಿ.ಎಂ.ಪಿ. ಬ್ಯಾಟರಾಯನಪುರ ಉಪ ವಿಭಾಗ

Assistant Executive Engineer
Byatarayanapura Sub Division
B.B.M.P. Bangalore